
N

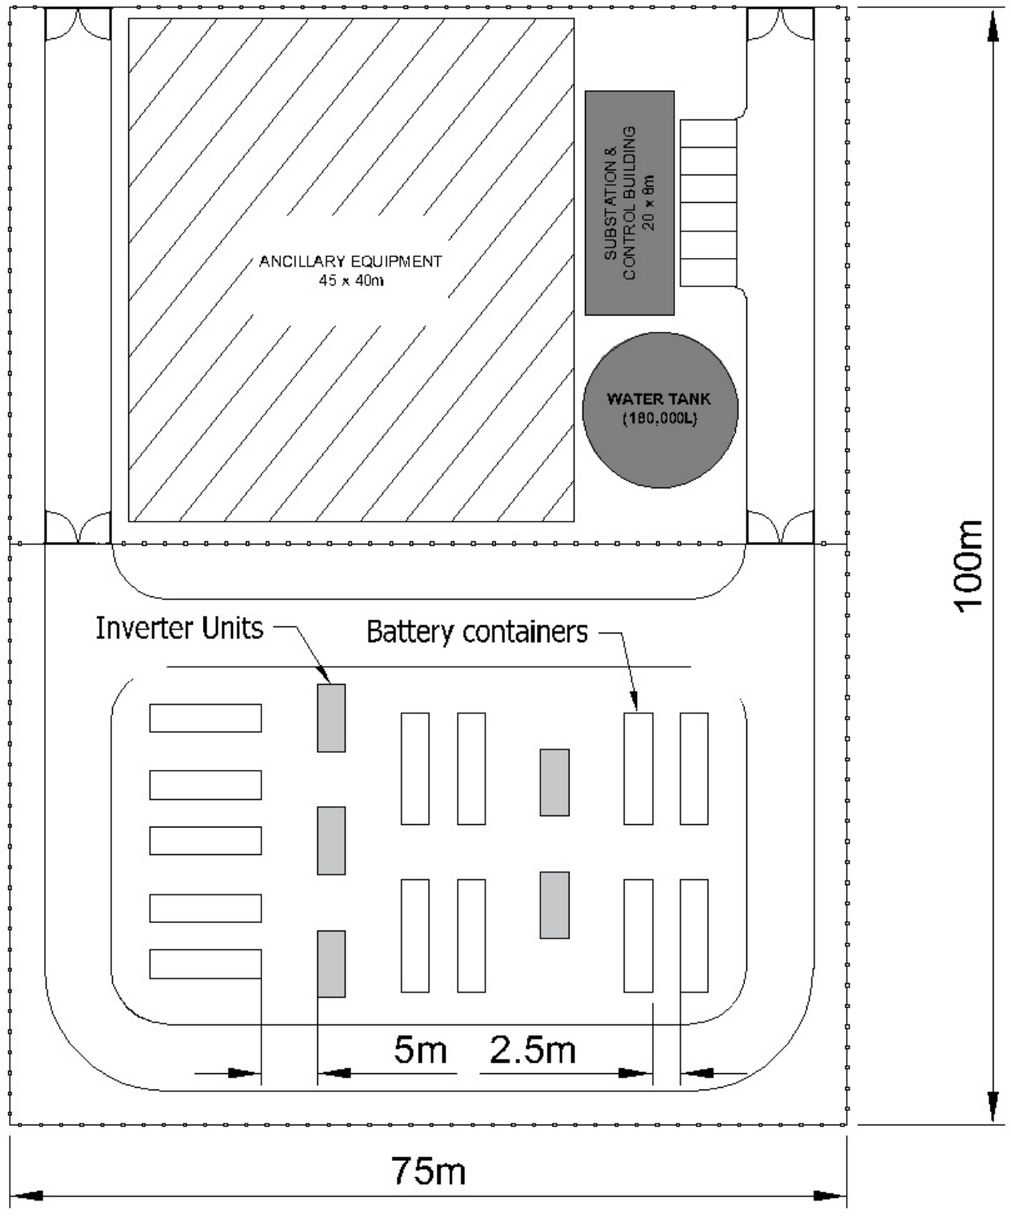

Corr Chnoc Wind Farm

Updated Figure AI 4.15
Indicative Substation & BESS Compound Layout

NOTES

1 Layout and Design provided is indicative only. Final arrangement shall be determined prior to construction

2 Battery Storage Facility to house thirteen battery storage containers.

3 Final electrical equipment and arrangement is to be confirmed post-consent.

4 Compound to be enclosed by 2.5-2.75m high palisade fence.

5 CCTV and/or motion lighting to be fitted.

6 Compound layout updated to reflect current NFCC guidance, including two vehicular access points and ancillary infrastructure.

Ref:	SAV-GE-CC-250826-01-01
Date:	25-08-2026
Paper Size:	A3
Scale:	NTS
Drawn by:	CN

© Crown copyright and database rights 2026 Ordnance Survey 0100031673. Contains public sector information licensed under the Open Government Licence v3.0.

GALILEO EMPOWER

5th Floor Cadworks
41 West Campbell Street
Glasgow
G2 6SE
savills